



Configuration A

The isolator wall has already a cable pass-through hole

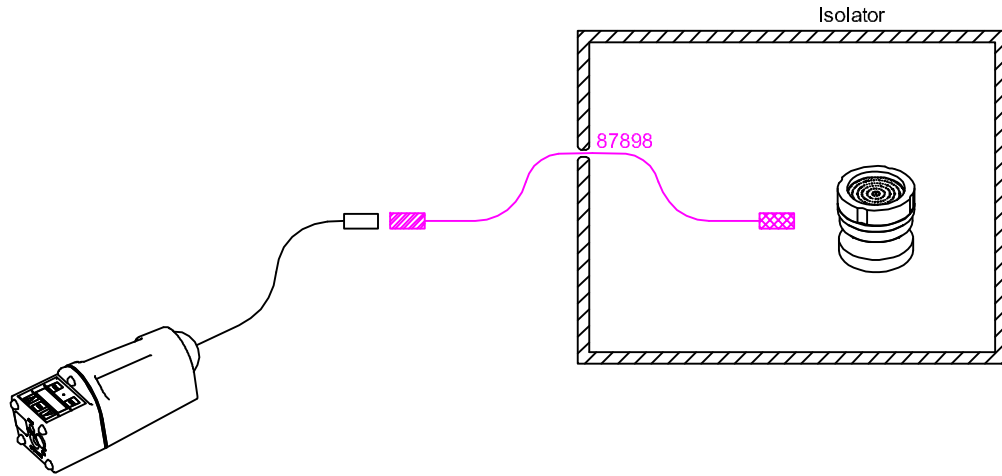


Configuration B

The isolator wall must be drilled and the installed cable can be removed

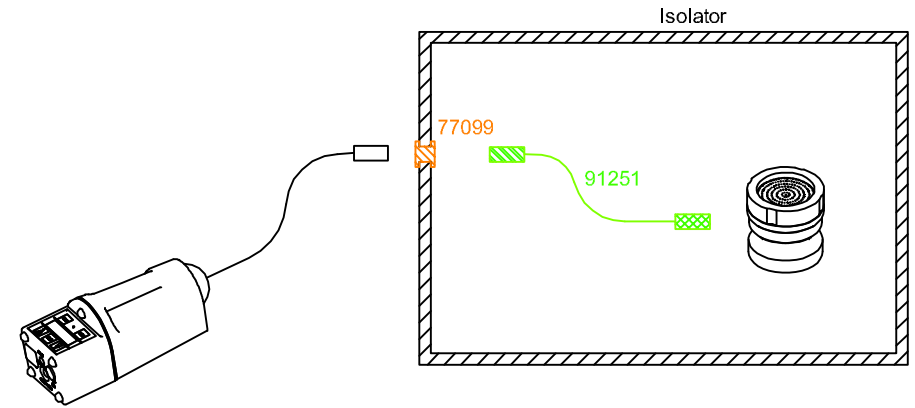

Configuration C

The isolator wall must be drilled and the installed cable is fixed to the wall

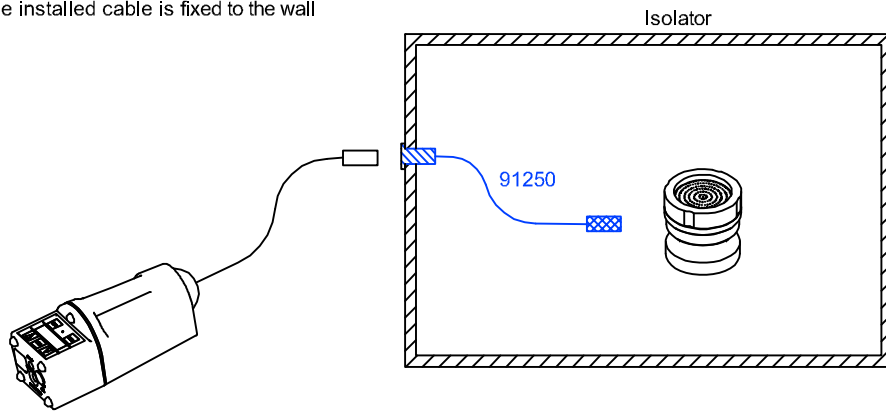

The main unit control cable has a standard length of 3mt

The 87898 extension cable has a standard length of 3mt

The 91251 extension cable has a standard length of 3mt

The 91250 extension cable has a standard length of 3mt

All the cabling can be supplied with a different cable length, the desired length must be specified in the purchase order